


APPENDIX 3

Licensing Act 2003

Annex 4 of Premises Licence Number: P1225

Approved Layout Plans


Ground Floor

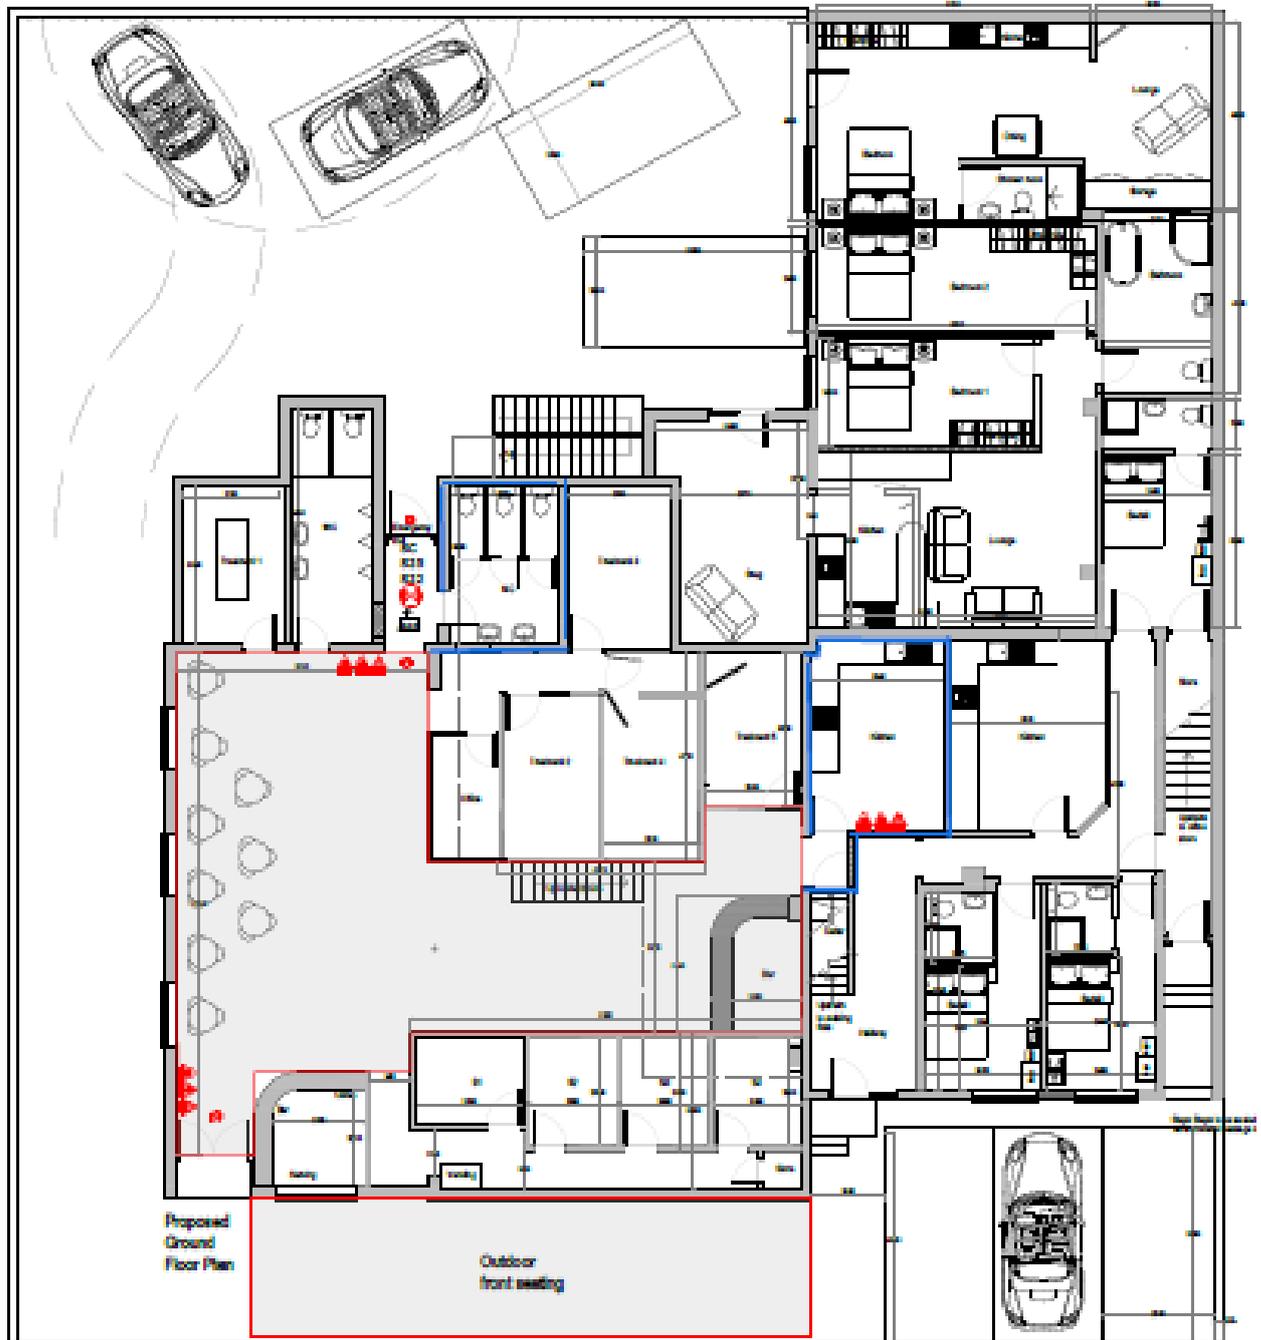

Scale 1:50

APPENDIX 3

Mezzanine Level

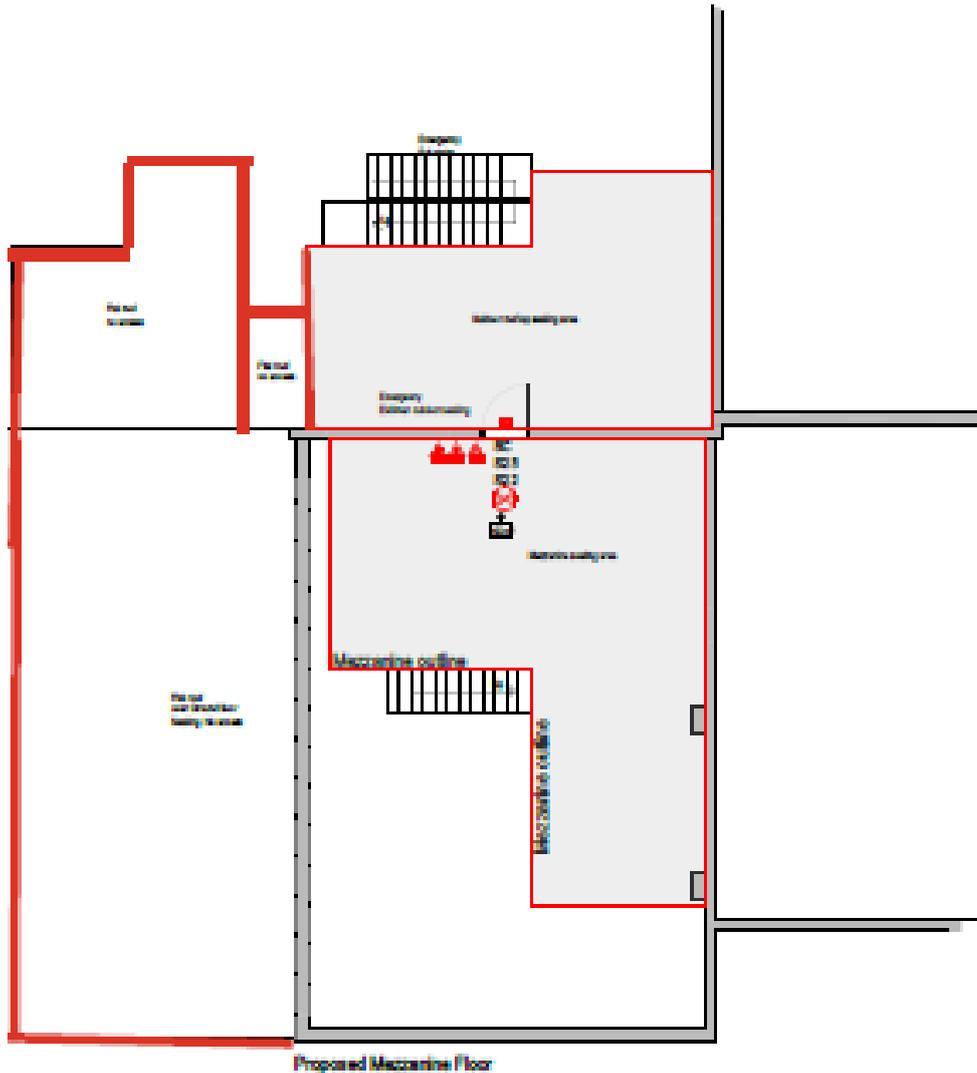

Proposed Mezzanine Floor

KEY

- SC SELF CLOSING DEVICE.
- FD305 1/2 HOUR FIRE DOOR FITTED WITH SMOKE STOP & INTUMESCENT STRIP IN ACCORDANCE WITH BS 476-P1.2.
-  FIRE BLANKET: FIXED TO THE WALL APPROX. 1500mm ABOVE FLOOR LEVEL, 1800x900mm IN SIZE.
- S22 EXIT SIGN TO BS 5499 PART 1 1990.
- S26 DIRECTIONAL EXIT SIGN TO BS 5499 PART 1 1990.
- S25 PUSH BAR TO OPEN SIGN TO BS 5499 PART 1 1990 AFFIXED TO FIRE DOOR
-  EMERGENCY LIGHT: (NON-MAINTAINED 1 HOUR DURATION) TO BS 5266 PART 1 1988.
-  EXTERNAL EMERGENCY LIGHTS.
-  FIRE DOOR KEEP LOCKED SHUT NOTICE.
-  9 LITRE WATER EXTINGUISHER.
-  2 kg DRY POWDER EXTINGUISHER.

EMERGENCY LIGHTING

Emergency lighting to be provided in the areas as indicated on plans and be such that when in operation the illumination given off to enable persons frequenting the premises to see their way out without general lighting, and also to illuminate all exit routes provided. Such lighting to be on a local sub-circuit and to be designed to BS 5266 Part 1 1988.

NOTE: Provide intumescent paint to all steelwork to achieve 60mins fire resistance.